

kanmor[®] - Data Brochure

Remote Display Module (RDM) 040e

D040e

04/07

The kanmor Remote Display Module (RDM) 040e provides the user with a remote interface to any kanmor control that is tN2 capable. The RDM can be used to view and / or adjust the settings on the control that it is connected to, or on any Room Temperature Unit (RTU) that may be connected to the control. The RDM can display any of the system and status indicators visible on the control or RTU. It also has a built in alarm contact that can be used to trigger an external alarm if either a control or sensor error occurs.

Definitions

The following defined terms and symbols are used throughout this manual to bring attention to the presence of hazards of various risk levels, or to important information concerning the life of the product.




Warning symbol: Indicates presence of hazards which can cause severe personal injury, death or substantial property damage if ignored.

Installation


STEP ONE — REMOVING THE FRONT COVER

Place a screwdriver or similar object into the small slot located in the top of the RDM. Push the screwdriver against the plastic tab, and pull the top of the front cover so that it pivots around the bottom edge of the RDM.




STEP TWO — MOUNTING THE RDM


The base of the RDM should be securely installed in the desired location. Mount the RDM directly to the desired location using two #6 - 1" screws. The screws are inserted through the mounting holes and must be securely fastened to the desired location. If possible, at least one of the screws should enter a wall stud or similar surface. If the RDM is to be mounted to an electrical box, use the included Wall Plate 008e. This plate mounts to the electrical box and the RDM will then mount to the plate.

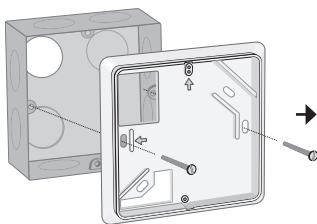

Mounting 008e
to electrical box



Mounting 040e
back to 008e

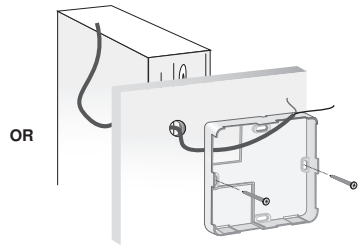


Mounting 040e
back to wall

STEP THREE — WIRING THE RDM

Run 18 AWG twisted pair or similar wire between the RDM and the control. The wires are to be stripped to a length of 9 mm (3/8"). Insert the wires through the hole provided in the back of the RDM enclosure and connect them to the *Com* and the *tN2* terminals. Do not run the wires parallel to telephone or power lines as this may interfere with the operation of the RDM. If the RDM wires are located in an area with strong sources of electromagnetic noise, shielded cable should be used or the wires can be run in a grounded metal conduit. If using shielded cable, the shield wire should be connected to the *Com* terminal on the control and not to earth ground.


Note: Do not apply power to the RDM. The RDM is to be wired directly to the control. The connection between the control and the RDM is polarity sensitive. The *Com* terminal of the RDM must be connected to the *Com* terminal of the control and the *tN2* terminal of the RDM must be connected to the appropriate terminal of the control. If the wires are reversed, the display on the RDM will remain blank and the control will display a short circuit error for the *tN2* device.

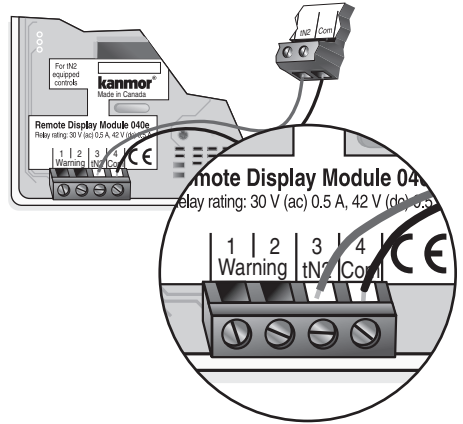

STEP FOUR — WIRING A REMOTE ALARM


The RDM comes with a built in alarm contact. This contact will close anytime either a sensor or control error is detected by the control. The contact will remain closed until the error is cleared. To clear the error message on the RDM and turn off the alarm relay, refer to the control Data Brochure. This contact will also close if a warning in the control is triggered. However, if a warning is triggered, the alarm contact will only remain closed for 60 seconds. After 60 seconds, the warning message will continue to be displayed, but the alarm contact will be shut off. To clear the warning message, the keypad of the RDM must be pressed as described in the control Data Brochure.

Between terminals 1 and 2, the contact is capable of switching a low voltage signal that is less than 0.5 Amps. This switch can be used to operate a low voltage alarm device directly, or it can be used to energize an external relay to trigger a line voltage or high current alarm device.

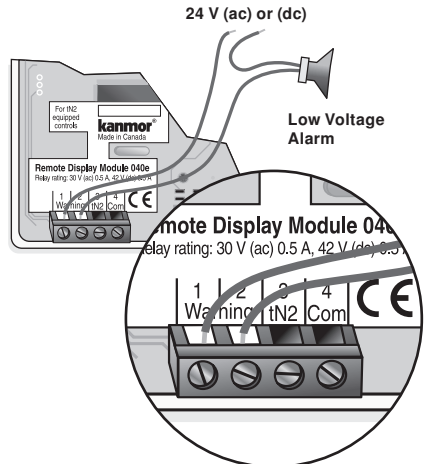

STEP FIVE — INSTALLING THE FRONT COVER

Align the hinges on the bottom of the front cover with the bottom of the RDM mounting base. Pivot the front cover around the bottom hinges and push the top against the mounting base until it snaps firmly in place.

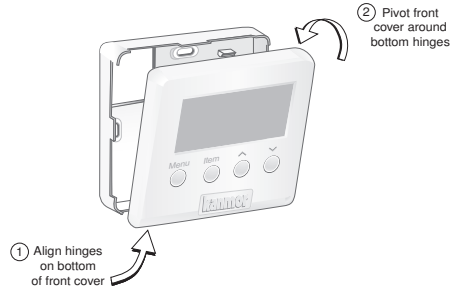

Settings

SELECTING THE DEVICE

The RDM can be used to view and / or adjust any of the settings on either the control or any of the RTU's connected to the control.

The device that is to be viewed or adjusted is selected as follows:

- Select the Miscellaneous (*Misc*) Menu by pressing the **Menu** button.
- Press the **Item** button until the word **DEVICE** is displayed in the LCD.
- Use the **▲** or **▼** buttons to select either the Control (CTRL) or one of the RTU's (RTU1, RTU2, ...).



Once the device has been selected, the RDM can be used to view and / or adjust the settings of the selected device.

TEMPERATURE UNITS

The RDM is capable of displaying the temperature in either °C or °F. In order to select the temperature units, press the **Menu** button until the Miscellaneous (*Misc*) menu is displayed. Next, press the **Item** button until the UNITS item is displayed. Then use the **▲** or **▼** button to select the desired units of measure.



ACCESS LEVELS

The RDM has four access levels that restrict the number of Menus, Items, and Adjustments that can be accessed by the user. The four access levels are Limited (LTD), User (USER), Installer (INST), and Advanced (ADV).

The access level of the RDM is found in the Miscellaneous (Misc) menu. The access level can only be viewed and / or adjusted when the Lock / Unlock DIP switch of the control that the RDM is connected to is set to the Unlock position. To determine if the RDM's access level is currently locked or unlocked, a small segment representing a padlock is viewed in the bottom right hand corner of the display.



Technical Data

REMOTE DISPLAY MODULE (RDM) 040e

Literature	D 040e
Packaged weight	225 g (0.5 lb.), Enclosure J, white PVC plastic
Dimensions	73 x 73 x 21 mm (2-7/8" H x 2-7/8" W x 13/16" D)
Approvals	CE approved, CSA C US, meets ICES & FCC regulations for EMI/RFI.
Ambient conditions	Indoor use only, 0 to 50°C (32 to 122°F), < 90% RH non-condensing Altitude <2000 m, Installation category II, Pollution category II.
Power Supply	kanmor control; tN2
Relay	30 V (ac) 0.5 A, 42 V (dc) 0.5 A
Included	008e

Limited Warranty and Product Return Procedure

Limited Warranty *The liability of kanmor Control Systems Ltd. ("kanmor") under this warranty is limited. The Purchaser, by taking receipt of any kanmor product ("Product"), acknowledges the terms of the Limited Warranty in effect at the time of such Product sale and acknowledges that it has read and understands same.*

The kanmor Limited Warranty to the Purchaser on the Products sold hereunder is a manufacturer's pass-through warranty which the Purchaser is authorized to pass through to its customers. Under the Limited Warranty, each kanmor Product is warranted against defects in workmanship and materials if the Product is installed and used in compliance with kanmor's instructions, ordinary wear and tear excepted. The pass-through warranty period is for a period of twenty-four (24) months from the production date if the Product is not installed during that period, or twelve (12) months from the documented date of installation if installed within twenty-four (24) months from the production date.

The liability of kanmor under the Limited Warranty shall be limited to, at kanmor's sole discretion: the cost of parts and labor provided by kanmor to repair defects in materials and/or workmanship of the defective product; or to the exchange of the defective product for a warranty replacement product; or to the granting of credit limited to the original cost of the defective product, and such repair, exchange or credit shall be the sole remedy available from kanmor, and, without limiting the foregoing in any way, kanmor is not responsible, in contract, tort or strict product liability, for any other losses, costs, expenses, inconveniences, or damages, whether direct, indirect, special, secondary, incidental or consequential, arising from ownership or use of the product, or from defects in workmanship or materials, including any liability for fundamental breach of contract.

The pass-through Limited Warranty applies only to those defective Products returned to kanmor during the warranty period. This Limited Warranty does not cover the cost of the parts or labor to remove or transport the defective Product, or to reinstall the repaired or replacement Product, all such costs and expenses being subject to Purchaser's agreement and warranty with its customers.

Any representations or warranties about the Products made by Purchaser to its customers which are different from or in excess of the kanmor Limited Warranty are the Purchaser's sole responsibility and obligation. Purchaser shall indemnify and hold kanmor harmless from and against any and all claims, liabilities and damages of any kind or nature which arise out of or are related to any such representations or warranties by Purchaser to its customers.

The pass-through Limited Warranty does not apply if the returned Product has been damaged by negligence by persons other than kanmor, accident, fire, Act of God, abuse or misuse; or has been damaged by modifications, alterations or attachments made subsequent to purchase which have not been authorized by kanmor; or if the Product was not installed in compliance with kanmor's instructions and/or the local codes and ordinances; or if due to defective installation of the Product; or if the Product was not used in compliance with kanmor's instructions.

THIS WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, WHICH THE GOVERNING LAW ALLOWS PARTIES TO CONTRACTUALLY EXCLUDE, INCLUDING, WITHOUT LIMITATION, IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, DURABILITY OR DESCRIPTION OF THE PRODUCT, ITS NON-INFRINGEMENT OF ANY RELEVANT PATENTS OR TRADEMARKS, AND ITS COMPLIANCE WITH OR NON-VIOLATION OF ANY APPLICABLE ENVIRONMENTAL, HEALTH OR SAFETY LEGISLATION; THE TERM OF ANY OTHER WARRANTY NOT HEREBY CONTRACTUALLY EXCLUDED IS LIMITED SUCH THAT IT SHALL NOT EXTEND BEYOND TWENTY-FOUR (24) MONTHS FROM THE PRODUCTION DATE, TO THE EXTENT THAT SUCH LIMITATION IS ALLOWED BY THE GOVERNING LAW.

Product Warranty Return Procedure All Products that are believed to have defects in workmanship or materials must be returned, together with a written description of the defect, to kanmor through its Representative. If kanmor receives an inquiry from someone other than a kanmor Representative, including an inquiry from Purchaser (if not a kanmor Representative) or Purchaser's customers, regarding a potential warranty claim, kanmor's sole obligation shall be to provide the address and other contact information regarding the appropriate Representative.

kanmor[®]
Control Systems

kanmor Control Systems Ltd.
5100 Silver Star Road
Vernon, B.C. V1B 3K4, CANADA
(250) 545-2693 Fax. 250 549-4349
Web Site: www.kanmor.com

