

kanmor® - Job Record

Power Manager 345e




J345e

01/08

Control Name / Location _____ Connected to Module _____

Terminal	Aux Pump Input	Bus	Power	Power
		tN4 & C	C & R	C & R
Control Label				
Model				
Location				
Bus #				
VA from left side module = _____ +		NA	_____ + _____	= _____

Total Tstat + Left Side Module VA
Max 56 VA

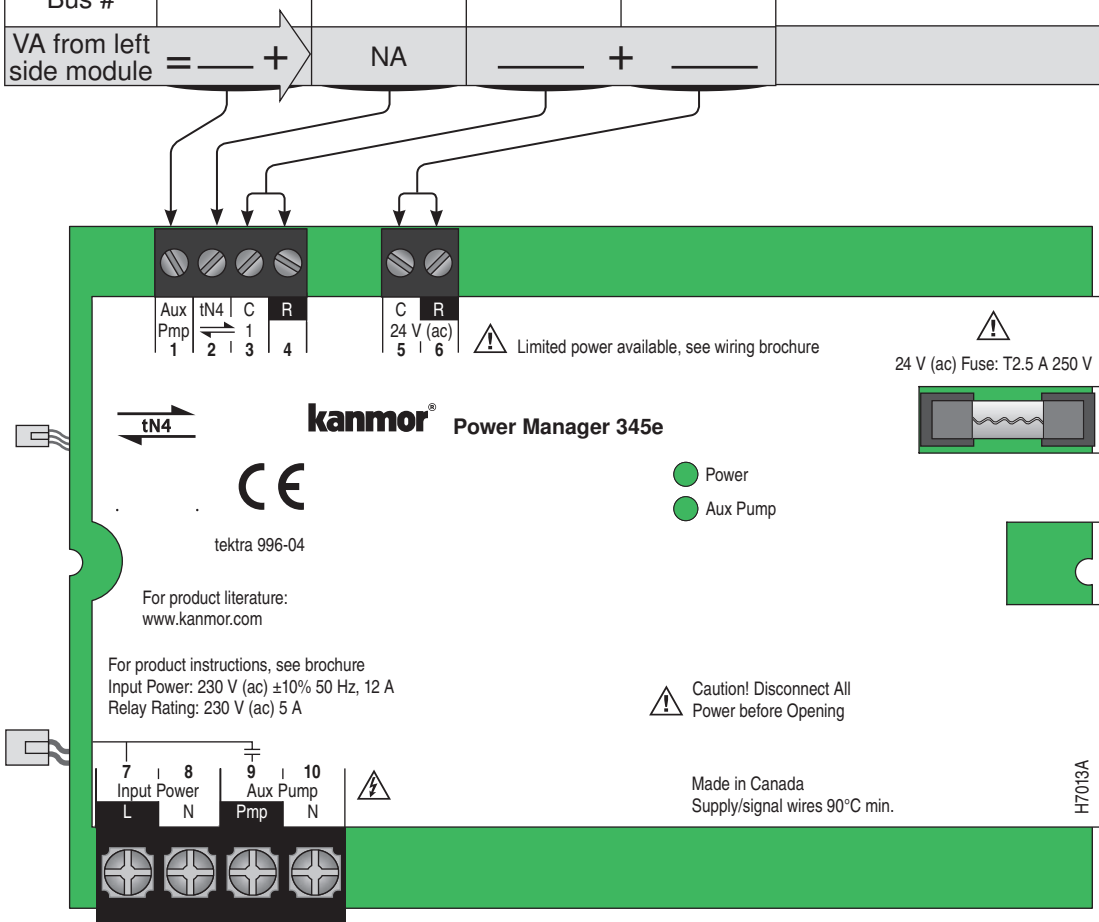

Line Voltage Input 230 V (ac)	Terminal	Aux Pmp
	Label	
Combined Total Amps + =	Make	
	Model	
	Amps	(Max. 5 A)
	Design Flow	
	Design Head	
Max. 11.5 A		

Notes:

Blank job records can be downloaded from the kanmor website at <http://www.kanmor.com>



kanmor Control Systems Ltd.
5100 Silver Star Road
Vernon, B.C. CANADA V1B 3K4
250-545-2693 Fax. 250-549-4349
Web Site: www.kanmor.com