

kanmor® - Job Record

Universal Reset Module 423e




J423e

01/08

Control Name / Location _____ Connected to Power Manager _____

Terminals	Boiler 1 Modulation	Boiler 2 Modulation	Boiler Bus Input	Bus 1 Input	Bus 2 Input	Bus 3 Input	DHW Sensor	Boiler Sensor	Outdoor Sensor
Label									
Make									
Model									
Notes									

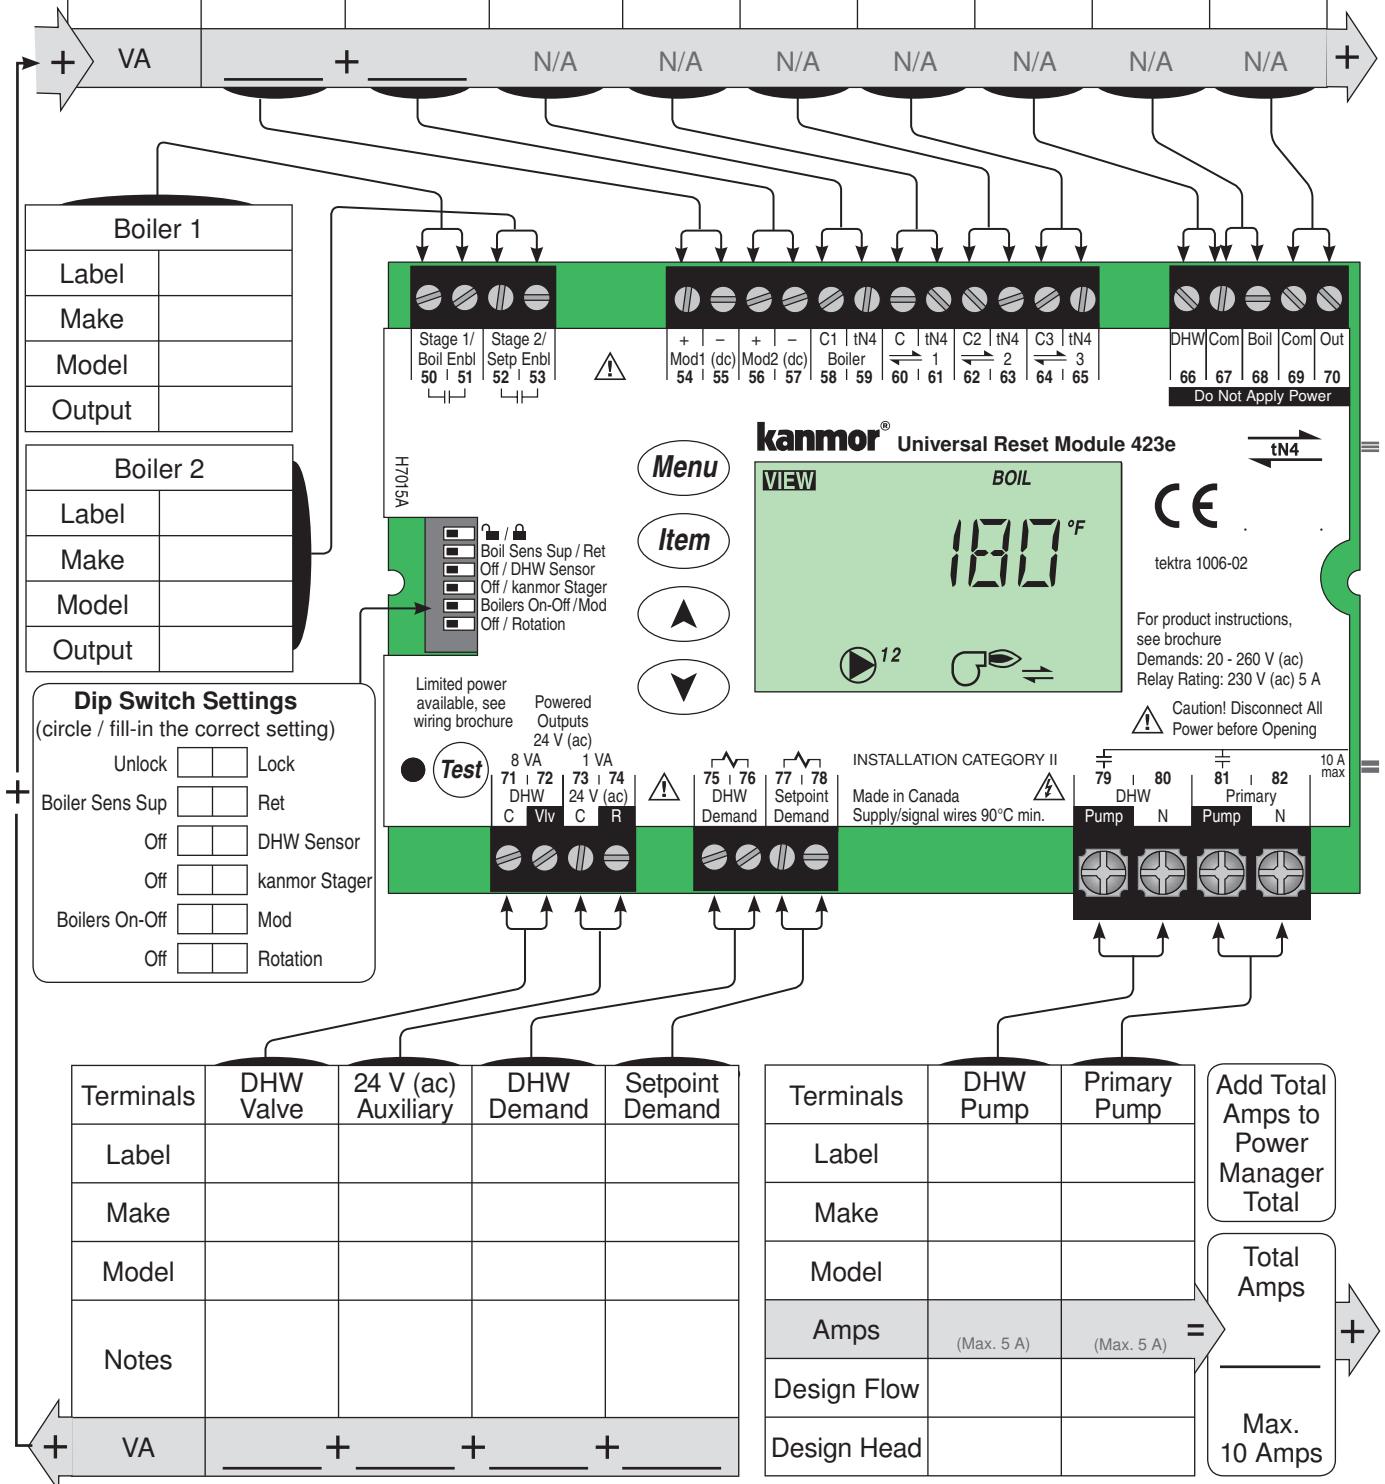

Menu Settings:

Item	Setting
BUS 1	
BUS 2	
BUS 3	
OUTDOOR DESIGN	
MIX 1 TERMINAL	
MIX 1 INDOOR	
MIX 1 DESIGN	
MIX 1 MINIMUM	
MIX 1 MAXIMUM	
MIX 1 MOTOR	
MIX 2 TERMINAL	
MIX 2 INDOOR	
MIX 2 DESIGN	
MIX 2 MINIMUM	
MIX 2 MAXIMUM	
MIX 2 MOTOR	
MIX 3 TERMINAL	
MIX 3 INDOOR	
MIX 3 DESIGN	
MIX 3 MINIMUM	
MIX 3 MAXIMUM	
MIX 3 MOTOR	
BOILER 1	
BOILER 2	

Item	Setting
BOILER TERMINAL	
BOILER INDOOR	
BOILER DESIGN	
BOILER MINIMUM	
BOILER MAXIMUM	
BOILER DIFFERENTIAL	
STAGE DELAY	
BOILER FIRE DELAY	
BOILER MOTOR	
BOILER MINIMUM MODULATION	
CYCLE LENGTH	
SCHEDULE	
DHW MODE	
DHW OCCUPIED	
DHW UNOCCUPIED	
DHW DIFFERENTIAL	
DHW EXCHANGE OCCUPIED	
DHW EXCHANGE UNOCCUPIED	
SETPOINT MODE	
SETPOINT OCCUPIED	
SETPOINT UNOCCUPIED	
WWSD OCCUPIED	
WWSD UNOCCUPIED	

Blank job records can be downloaded from the kanmor website at <http://www.kanmor.com>

kanmor [®] Control Systems	kanmor Control Systems Ltd. 5100 Silver Star Road Vernon, B.C. CANADA V1B 3K4 250-545-2693 Fax. 250-549-4349 Web Site: www.kanmor.com	
-----------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--